


Consumer Confidence Report

Naval Support Activity South Potomac Naval Support Facility Dahlgren Dahlgren, VA



Virginia Public Water System: VA6099340

Your tap water meets all Environmental Protection Agency, State of Virginia, and Department of the Navy drinking water health standards.

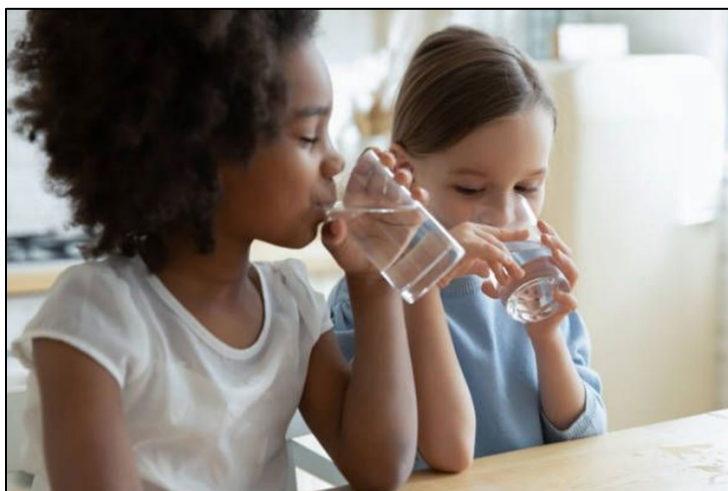

Children Drinking a Glass of Water. Source: drinkingwaterfountain.co

Annual Drinking Water Quality Report

Naval Support Activity South Potomac is pleased to present the 2024 Naval Support Facility Dahlgren (NSFDL) annual water quality report, or Consumer Confidence Report (CCR), as required by the Safe Drinking Water Act. This CCR includes testing performed between January 1 and December 31, 2024. **Testing indicates NSFDL's drinking water supply was in full compliance with federal and state of Virginia Safe Drinking Water Act standards during 2024.** NSFDL is committed to providing high-quality, safe, and reliable drinking water service to you every day, while also working hard to provide details about where your water originates, what constituents it contains, and how it measures up to safe drinking water standards set by regulatory agencies. The 2024 drinking water monitoring schedule established by the Virginia Department of Health (VDH), included collection of routine monthly bacteria samples, annual nitrate/nitrite samples, and monitoring chlorine disinfectant residuals, disinfection byproducts, and the like.

Special Precautions and Health Information

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Water Drinking Hotline at (800) 426-4791.



Children Drinking Water from a Spigot. Source: Pezibear, Pixabay

Substances Expected to be in Drinking Water

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline at (800) 426-4791 or by visiting <https://www.epa.gov/ccl/types-drinking-water-contaminants>.


The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Potential contaminants that may be present in source water include: (1) microbial contaminants, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife; (2) inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban stormwater runoff, industrial, or domestic wastewater discharges, oil and gas production, mining, or farming; (3) pesticides and herbicides, which may come from a variety

of sources such as agriculture, urban stormwater runoff, and residential uses; (4) organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, and septic systems; and (5) radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, EPA developed regulations that limit the amount of certain contaminants in water provided by public water systems. The Food and Drug Administration has regulations that establish limits for contaminants in bottled water, which must provide the same protection for public health.

Water Source Information

Drinking water produced by NSFDL is comprised entirely of groundwater. No surface water enters the drinking water system. Water is pumped from 600 to 800 feet below ground from the Potomac Aquifer, which is a deep geologic feature that primarily recharges with the slow downward percolation of rainwater. This rate is so slow, that if rain fell today, it would take nearly one thousand years to reach the aquifer.

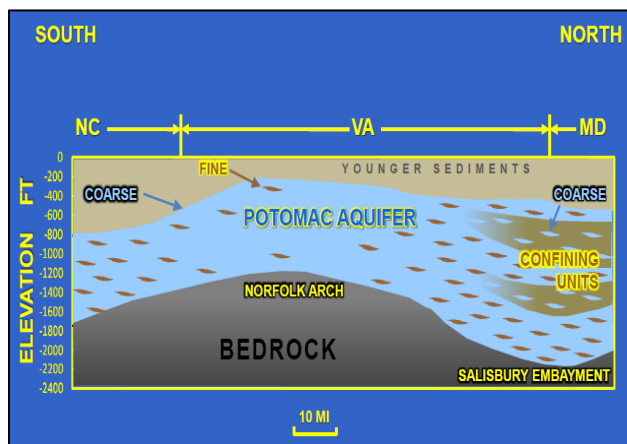

The Source of Your Drinking Water is the Potomac Aquifer.
Source: Randy McBride, U.S. Geological Survey, *The Potomac Aquifer of the Virginia Coastal Plain*



Water Bottle Pouring Into Glass. Source: congerdesign, Pixabay

A system of three water wells, all located on the southern portion of NSFDL, are used to bring groundwater to the surface where it is treated by disinfection, pressurized or sent to water towers for storage, and distributed to NSFDL consumers. Disinfection of the groundwater is done by the addition of chlorine to kill any bacteria and microorganisms that may be in the water and it continues to disinfect water as it travels through pipes. Disinfection is considered one of the major public health advances of the 20th century. If you object to the chlorine taste of your tap water, try placing the water in an uncovered pitcher in the refrigerator overnight. This will reduce the chlorine taste.

Source Water Assessment and its Availability

VDH conducted a source water assessment of NSFDL's drinking water system in April 2020 and determined it to be of high susceptibility to contamination based on using State-developed criteria in their approved Source Water Assessment Program. The assessment report consists of maps showing the source water assessment area, an inventory of known land use activities of concern, and documentation of any known contamination within the five years prior. The assessment is available at <https://www.vdh.virginia.gov/drinking-water/source-water-programs/source-water-protection-program/>.

Note to Users of Infrequently Used Facilities

Some of the facilities at NSFDL have low or infrequent water use. To ensure that drinking water in these low-use facilities maintain proper chlorination, the Public Works Water Utilities operators regularly exercise the fire hydrants to keep chlorination levels elevated and fresh water moving through the system. First thing in the morning or after long periods without use, it may be desirable to allow fixtures to flow for a few minutes before water use. If you require assistance regarding infrequently used facilities, please call NSFDL Public Works Drinking Water Program Manager at (540) 295-7146.



Water Droplets. Source: PublicDomainPictures from Pixabay

Note to Sodium Sensitive Groups

The drinking water at NSFDL contains levels of sodium that measured between 90 and 96 milligrams per liter (mg/L) in 2024. The U.S. Department of Agriculture and the Department of Health and Human Services jointly publish the Dietary Guidelines for Americans every five years, with the current version of the Guidelines being from 2020–2025, and recommends individuals reduce daily sodium intake to less than 2,300 mg. Each individual should always consult his or her health care provider before adopting any dietary regimen.

Water Quality Information

In order to ensure that tap water is safe to drink, the EPA requires regulations that limit the amount of contaminants in water provided by public water systems. Tables 1, 2, and 3 on the following page list all of the drinking water contaminants detected during the calendar year of this report. Older data is included since the EPA and/or the state of Virginia requires NSFDL to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not vary significantly from year to year, or the system is not considered vulnerable to this type of contamination.

As such, some of NSFDL's data, though representative, may be more than one-year-old. Although the Public Works Drinking Water Program tested for many contaminants, only those listed in Tables 1 and 2 were found in your water.

All sources of drinking water contain some naturally occurring contaminants. At low levels, these substances are generally not harmful in NSFDL's drinking water system. Removing all contaminants would be extremely expensive, and in most cases, would not provide increased protection of public health. A few naturally occurring minerals may actually improve the taste of drinking water and have nutritional value at low levels.

Within Tables 1, 2, and 3, you may find terms and abbreviations that are familiar to you. To help you better understand these terms, NSFDL has provided a definitions chart below.



Water Recycle Droplet. Source: ClipArt.com

Drinking Water Definitions

Units	Definition
ppm	parts per million, or milligrams per liter (mg/L)
ppb	parts per billion, or micrograms per liter (µg/L)
ppt	parts per trillion, or nanograms per liter (ng/L)
pCi/L	picocuries per liter (a measure of radioactivity)
positive samples/month	Number of samples taken monthly that were found to be positive
% positive samples/month	Percent of samples taken monthly that were positive
NA	Not applicable
ND	Not detected
NR	Monitoring not required, but recommended
NTU	Nephelometric Turbidity Unit
MCLG	Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.
MCL	Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.
SMCL	Secondary Maximum Contaminant Level: Non-enforceable guidelines regarding chemicals that may cause cosmetic or aesthetic effects in drinking water.
TT	Treatment Technique: A required process intended to reduce the level of a contaminant in drinking water.
AL	Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.
Variances and Exemptions	State or EPA permission not to meet an MCL or a treatment technique under certain conditions.
MRDLG	Maximum residual disinfection level goal. The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
MRDL	Maximum residual disinfectant level. The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
MNR	Monitored Not Regulated
MPL	State Assigned Maximum Permissible Level

Table 1. Detected Contaminants (Federal)

Contaminants	MCLG or MRDLG	MCL, AL TT, or MRDL	NSFDL Water	Range		Sample Date	Violation	Typical Source
				Low	High			
Disinfectants & Disinfection By-Products								
Chlorine (as Cl2) (ppm)	4	4	1.8	0.2	1.8	2024	No	Water additive used to control microbes
Total Trihalomethanes (TTHMs) (ppb)	NA	80	15.9	7.5	15.9	2024	No	By-product of drinking water disinfection
Haloacetic Acids (HAA5) (ppb)	NA	60	4.8	2.8	4.8	2024	No	By-product of drinking water disinfection
Inorganic Contaminants								
Fluoride (ppm)	4	4	0.9	0.7	0.9	2023	No	Erosion of natural deposits; Water additive which promotes strong teeth;
Turbidity (NTU)	NA	TT single result > 1 NTU	0.40	0.30	0.40	2023	No	Erosion of natural deposits
Radioactive Contaminants								
Alpha emitters (pCi/L)	0	15	9.2	2.0	9.2	2023	No	Erosion of natural deposits
Combined Radium (pCi/L)	0	5	*0.6	*0.4	*0.6	2024	No	Erosion of natural deposits * Reservoir well retested in 2024
Lead & Copper								
Lead (ppb) 90 th Percentile	0	15	<2	<2	<2	2022	No	Lead Service Lines; Corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives
Copper (ppm) 90 th percentile	1.3	1.3	0.220	0.037	0.240	2022	No	Corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives

Note: Ninety (90) percent of the samples collected were at or below the level reported for our water. Lead and copper were last tested for in 2022. Testing will be done in 2025 to meet requirements. To assess corrosion of lead and copper, NSFDL conducts tap sampling for lead and copper at selected sites every three years.

Information About Lead: Lead can cause serious health effects in people of all ages, especially pregnant people, infants (both formula-fed and breastfed), and young children. Lead in drinking water is primarily from materials and parts used in service lines and in home plumbing. Naval Support Facility Dahlgren is responsible for providing high quality drinking water and removing lead pipes, but cannot control the variety of materials used in the plumbing in your home. Because lead levels may vary over time, lead exposure is possible even when your tap sampling results do not detect lead at one point in time. You can

help protect yourself and your family by identifying and removing lead materials within your home plumbing and taking steps to reduce your family's risk. Using a filter, certified by an American National Standards Institute accredited certifier to reduce lead, is effective in reducing lead exposures. Follow the instructions provided with the filter to ensure the filter is used properly. Use only cold water for drinking, cooking, and making baby formula. Boiling water does not remove lead from water. Before using tap water for drinking, cooking, or making baby formula, flush your pipes for several minutes. You can do this by running your tap, taking a shower, doing laundry or a load of dishes. If you have a lead service line or galvanized requiring replacement service line, you may need to flush your pipes for at least 5 minutes to flush water from both your home plumbing and the lead service line. If you are concerned about lead in your water and wish to have your water tested, contact NSFDL-Environmental at (540)295-7146 for available resources. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available at <https://www.epa.gov/safewater/lead>.

In an effort to ensure the safest water possible, the State required NSFDL to monitor several contaminants not required by Federal regulations. Of those contaminants, only the ones listed below were found in your water.

Table 2. Detected Contaminants (State)

Contaminants	State SMCL	NSFDL Water	Sample Date	Explanation and Comment
Hardness (ppm)	NA	2.2	2023	Erosion of natural deposits
Total Alkalinity (ppm)	NA	189	2023	Erosion of natural deposits
Dissolved Silica (ppm)	NA	38	2023	Erosion of natural deposits
Total Calcium (ppm)	NA	0.76	2023	Erosion of natural deposits
Total Dissolved Solids (ppm)	500	526	2023	Erosion of natural deposits
Chloride (ppm)	250	4.3	2023	Erosion of natural deposits
Sulfate (ppm)	250	13.4	2023	Erosion of natural deposits
Sodium	No SMCL	96.2	2023	Erosion of natural deposits

The following contaminants were monitored for, but not detected, in your water.

Table 3. Undetected Contaminants

Contaminants	MCLG or MRDLG	MCL, TT, or MRDL	NSFDL Water	Sample Date	Violation	Typical Source
Nitrate (measured as Nitrogen) (ppm)	10	10	ND	2024	No	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits
Nitrite (measured as Nitrogen) (ppm)	1	1	ND	2024	No	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits
Microbiological						
Coliform (positive samples/month)	0	1	ND	2024	No	Naturally present in the environment

Water Conservation Tips

Did you know that the average U.S. household uses approximately 400 gallons of water per day or 100 gallons per person per day? Luckily, there are many low-cost and no-cost ways to conserve water. .



Uses for Water. Source: Mees Groothuis from Pixabay

Small changes can make a big difference – try one today and soon it will become second nature.

- Take short showers – a 5-minute shower uses 4 to 5 gallons of water compared to up to 50 gallons for a bath.
- Shut off water while brushing your teeth, washing your hair and shaving and save up to 500 gallons a month.
- Use a water-efficient showerhead. They are inexpensive, easy to install, and can save you up to 750 gallons a month.
- Run your washing machine and dishwasher only when they are full. You can save up to 1,000 gallons a month.
- Water plants only when necessary.
- Fix leaky toilets and faucets. Faucet washers are inexpensive and take only a few minutes to replace. To check your

toilet for a leak, place a few drops of food coloring in the tank and wait. If it seeps into the toilet bowl without flushing, you have a leak. Fixing it or replacing it with a new, more efficient model can save up to 1,000 gallons a month.


- Adjust sprinklers so only your lawn is watered. Apply water only as fast as the soil can absorb it and during the cooler parts of the day to reduce evaporation.
- Teach your kids about water conservation to ensure a future generation that uses water wisely. Make it a family effort to reduce next month's water bill!
- Visit www.epa.gov/watersense for more information.

Cross Connection Control Tips

Drinking water normally flows from the source through the distribution (plumbing) system to the consumer. However, under certain conditions, contaminated water can flow in the reverse direction or “backflow” into the drinking water supply. The point at which this occurs is known as a cross connection. Cross connections can be either direct physical piping connections or potential connections such as garden hoses and faucets. Cross connections occur in many places throughout the distribution system. Examples of common cross connections in residences include dishwashers, garbage disposal units, hand-held showerheads, whirlpool tubs, toilets, faucets, and any unit onto which a hose may be attached. Common commercial and/or industrial cross connections occur at boiler units, fire sprinkler systems, and auxiliary water supply systems.

Backflow of potentially contaminated water is caused by a pressure differential, either back-siphonage or backpressure. Back-siphonage is the presence of a partial vacuum or lack of pressure in the supply line causing the contents further downstream to be siphoned or sucked back into the supply line. Back-siphonage may occur when the water pressure coming into your

home suddenly drops due to a water main break, flushing, or pump failure. Back pressure occurs when there is greater pressure downstream (as caused by pumping, elevation, steam or air pressure) in the distribution system pushing contaminants back into the supply line. Backflow of contaminated water through unprotected cross connections has led to outbreaks of illness. Chemical and microbiological contaminants introduced via backflow may have acute health effects including gastrointestinal illness, organ damage, and neurological effects such as blurred vision, headache, and paresthesia. Backflow is controlled by the use of backflow prevention devices. There are numerous types of backflow prevention devices, and applicability depends on the cross connection, water use, and plumbing structure. These devices are installed on the plumbing system or incorporated into the design of the plumbing fixture.

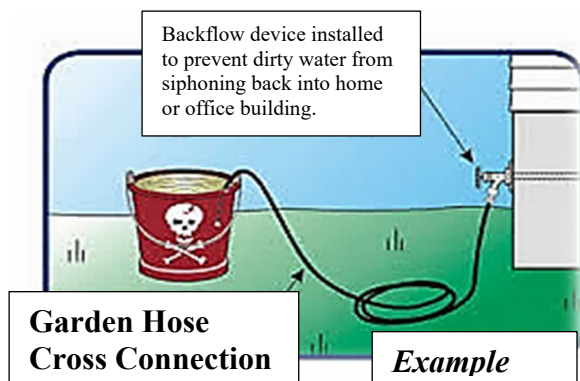

Cross Garden Hose Connection. Source: Maury County Water System, Backflow Prevention

NSFDL is in accordance with applicable Federal and State laws and regulations, and has a program in place to control cross connection and prevent backflow of contamination into the drinking water supply. This program consists of routine surveys to identify and address actual and potential cross connection hazards and annual inspections of backflow prevention devices to ensure proper functioning. As consumers of the drinking water, all users play a vital role in protection of the drinking water supply.



*Fire Hydrant Flushing at Naval Support Facility Dahlgren.
Source: NSFDL Stock Photo*

Here are some tips you can use to control cross connections and prevent backflow:

- Do not leave hoses submerged in buckets, sinks, puddles or other containment units.
- Do not use hoses to unclog blocked toilets, sewers, etc.
- Never install plumbing hardware onto the supply system without obtaining prior approval of the device(s) from the Navy's Public Works Waterworks.
- Notify NSFDL Public Works Drinking Water Program Manager immediately if there is any indication or suspicion that contaminated water has entered the water supply system by backflow.

For more information or to report an issue regarding cross connection control and backflow prevention, contact the NSFDL Public Works Drinking Water Program Manager at (540) 295-7146.

Lead Service Line Inventory

The EPA's Lead and Copper Rule Revisions required Naval Support Facility Dahlgren to develop a pipe material service line inventory by October 16, 2024. There was a total of 416 service lines found, of which 127 were nonlead, 57 galvanized requiring replacement, and 239 were unknown lead service lines. This inventory is available upon request and will be updated annually.

Lead in Priority Areas

Lead exposure from drinking water pipes, fittings, or outlets is a particular concern for children. The EPA recommends schools and childcare facilities test the lead content of drinking water. The Navy adopted the recommendation as policy and tests the Dahlgren School, Child Development, Youth Activity, and Teen Centers every five years.



Corroded Lead Pipe. Source: Creative Commons

Between November 16 and December 24, 2024, NSFDL tested 168 water outlets for lead in accordance with established sampling protocols. Of those outlets, two exceeded the Navy's established 10 parts per billion (ppb) action level for lead. These outlets were seldomly used sources of drinking water. NSFDL initially reported one of the sites (Child Development Center Building 437, Room 102) as 10.7 ppb, but the actual concentration was 27 ppb. NSFDL personnel replaced and retested this fixture. The new test result was less than 0.5 ppb. The other faucet was removed from service because it also

exceeded the 10 ppb level, thus ensuring the safety of children and staff. NSFDL plans to conduct sampling again in 2029 and will provide advance notification to parents, caregivers, and staff. To learn more about lead in drinking water in schools and day care centers, visit the following EPA website:

https://www.epa.gov/system/files/documents/2024-10/final_lcri_fact-sheet_schools-and-child-care.pdf.

Additional Information for Lead

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. For additional information on lead in drinking water, visit EPA's website at <https://www.epa.gov/ground-water-and-drinking-water/basic-information-about-lead-drinking-water>.

The law currently allows end use fixtures, such as faucets, with less than 0.25% lead to be labeled as "lead free." Visit the National Sanitation Foundation website to learn more about lead-containing plumbing fixtures at


<https://www.nsf.org/consumer-resources/articles/faucets-plumbing-products>.

When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. Use water only from the cold-water tap for drinking, cooking, and especially making baby formula, as hot water may contain higher levels of lead. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline at (800) 426-4791 or via <http://www.epa.gov/safewater/lead>.



CONCERNED ABOUT LEAD IN YOUR DRINKING WATER?

Sources of **LEAD** in Drinking Water

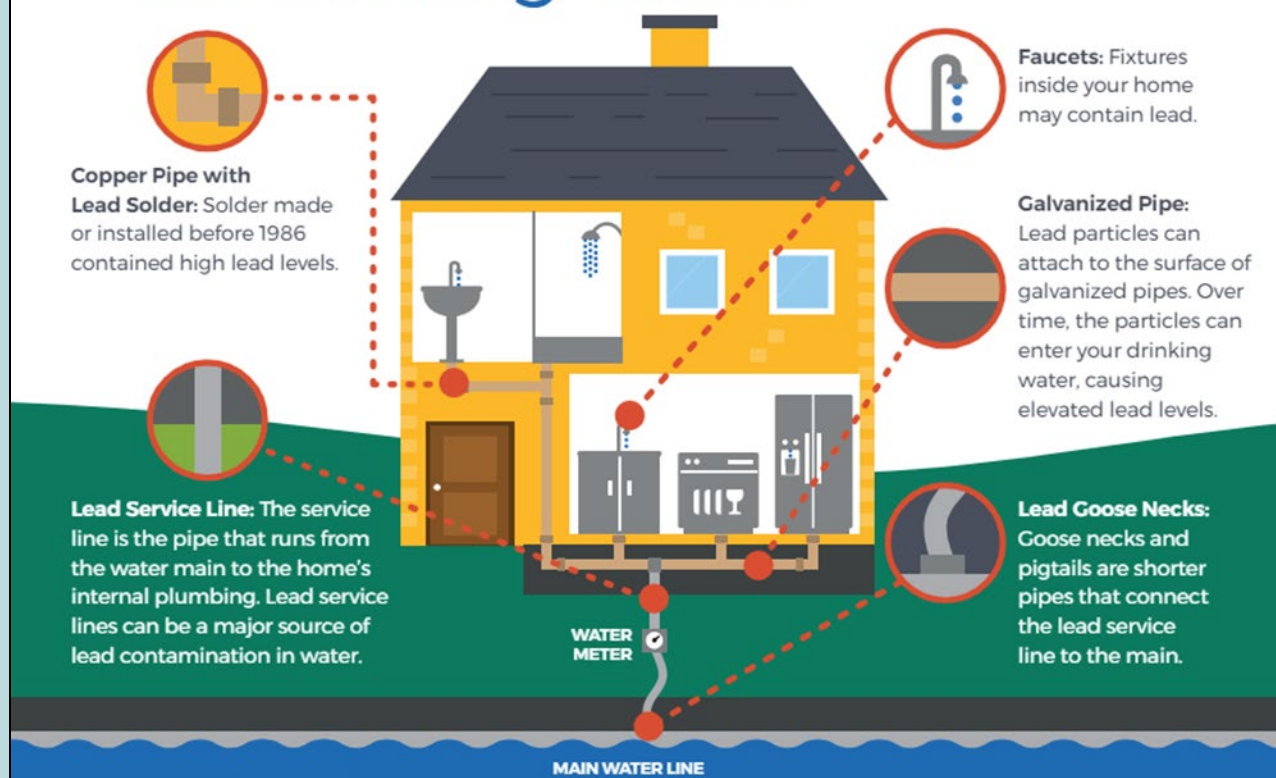

Reduce Your Exposure To Lead



Use only cold water for drinking, cooking and making baby formula. *Boiling water does not remove lead from water.*



Regularly clean your faucet's screen (also known as an aerator).



Consider using a water filter certified to remove lead and know when it's time to replace the filter.



Before drinking, flush your pipes by running your tap, taking a shower, doing laundry or a load of dishes.

To find out for certain if you have lead in drinking water, **have your water tested.**

Lead in Drinking Water. Source: EPA

What Are Per- and Polyfluoroalkyl Substances and Where Do They Come From?

Per- and polyfluoroalkyl substances (PFAS) are a group of thousands of man-made chemicals. PFAS have been used in a variety of industries and consumer products around the globe, including in the U.S., since the 1940s. PFAS have been used to make coatings and products that are used as oil and water repellents for carpets, clothing, paper packaging for food, and cookware. They are also contained in some foams (aqueous film-forming foam or AFFF) currently used for fighting petroleum fires at airfields and in industrial fire suppression processes. PFAS chemicals are persistent in the environment, and some are persistent in the human body—meaning they do not break down and they can accumulate over time.

Is There a Regulation for PFAS in Drinking Water?

On April 10, 2024, the EPA established maximum contaminant levels (MCLs) for a subset of PFAS chemicals (see Table 4).

EPA requires implementation of sampling in accordance with the new MCLs within three years of the publication date and implementation of any required treatment within five years.

Table 4. EPA PFAS MCLs

Compound	Final MCLG	Final MCL (Enforceable Levels)
PFOA	Zero	4.0 ppt
PFOS	Zero	4.0 ppt
PFHxS	10 ppt	10 ppt
PFNA	10 ppt	10 ppt
HFPO-DA (commonly known as GenX Chemicals)	10 ppt	10 ppt
Mixtures containing two or more of PFHxS, PFNA, HFPO-DA, & PFBS	1 (unitless) Hazard Index	1 (unitless) Hazard Index

Has Naval Support Facility Dahlgren Tested Its Water for PFAS in 2024?

Yes. In April and October 2024, Unregulated Contaminant Monitoring Rule 5 samples were collected from all NSFDL drinking water wells. We are pleased to report that drinking water testing results were below the Method Reporting Limit for all compounds covered by the sampling method, including lithium, PFOA, and PFOS. This means that these chemicals were not detected in your water.

Initial monitoring for PFAS at NSFDL in accordance with EPA requirements is complete. Based on these results, the installation will continue to investigate if operational or treatment controls are needed. Additional sampling beyond the regulatory requirements may be conducted.

For More Consumer Confidence Report Information, Please Contact:

Drinking Water Program Manager
Adrian Mood, Public Works Environmental
18329 Thompson Rd, Bldg. 182, Suite 226
Dahlgren, VA 22448
Phone: (540) 295-7146
Email: adrian.k.mood.civ@us.navy.mil

Utilities, Water Leaks, or Related, Please Contact:

Utilities Branch Head
Kevin Burgess, Utilities
18329 Thompson Rd, Bldg. 120M
Dahlgren, VA 22448
Phone: (301) 399-9028
Email: kevin.d.burgess.civ@us.navy.mil
